


ESQUEMA PARA REGULACIÓN MEDIANTE VARIADOR



EL VARIADOR ESTA PROGRAMADO

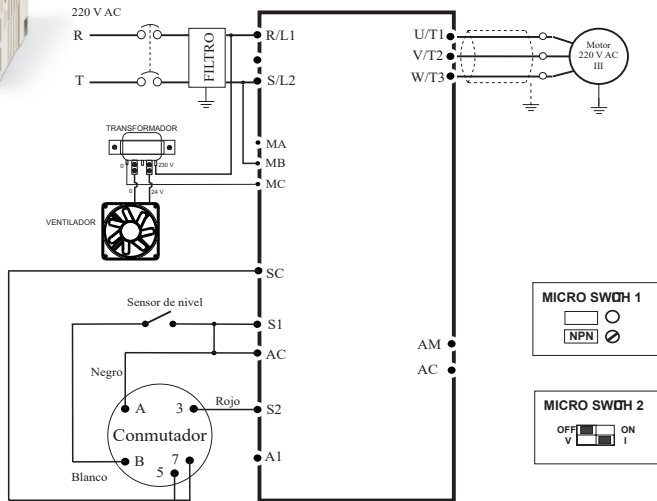

PARAMETRO	Dostec-50	Dostec-40, MF
	1C.V.	0.5 C.V.
A1-01	0	0
B1-01	0	0
B1-02	1	1
B1-17	1	1
C1-01	0.1	0,1
C1-02	0.1	0,1
C3-01	1.0	1,0
D1-01	5,0	5,0
D1-17	50,00	50,00
E1-01	220	220
E1-04	60,0*	60,0*
E1-05	220,0	220,0
E1-07	5,0	5,0
E1-08	22,0	22,0
E1-09	5,0	5,0
E1-10	22,0	30,0
E2-01	2,60	2,60
H1-02	6	6
H2-01	1	1
H3-01	2	2
L1-01	2	2
O4-01	3	0
O4-03	1	0
U2-02	B	0

ESQUEMA PARA REGULACION MEDIANTE CONTROLLER

PARAMETRO	Dostec-50	Dostec-40, MF
	1C.V.	0.5 C.V.
A1-01	0	0
B1-01	0	0
B1-02	1	1
B1-17	1	1
C1-01	0.1	0,1
C1-02	0.1	0,1
C3-01	1.0	1,0
D1-01	5,0	5,0
D1-17	50,00	50,00
E1-01	220	220
E1-04	60,0*	60,0*
E1-05	220,0	220,0
E1-07	5,0	5,0
E1-08	22,0	22,0
E1-09	5,0	5,0
E1-10	22,0	30,0
E2-01	2,60	2,60
H1-02	6	6
H2-01	1	1
H3-01	2	2
L1-01	2	2
O4-01	3	0
O4-03	1	0
U2-02	B	0

